



Environmental Product Declaration

In accordance with ISO 14025:2006 and EN 15804:2012+A2:2019/AC:2021 for:

Fan Coils – Carisma CRC-ECM

From **Sabiana S.p.A.**

EPD of multiple products, based on a representative product.

Included products:

- 2 pipe: CRC-ECM 23, 24, 43, 44, 63, 64, 73, 74, 93, 94
- 4 pipe: CRC-ECM 23+1, 23+2, 24+1, 43+1, 43+2, 44+1, 63+1, 63+2, 64+1, 73+1, 73+2, 74+1, 93+1, 93+2, 94+1

Programme:	The International EPD [®] System, www.environdec.com
Programme operator:	EPD International AB
EPD registration number:	EPD-IES-0015752
Publication date:	2024-07-31
Valid until:	2029-07-31

An EPD should provide current information and may be updated if conditions change. The stated validity is therefore subject to the continued registration and publication at www.environdec.com

General information

Programme information

Programme:	The International EPD® System
Address:	EPD International AB Box 210 60 SE-100 31 Stockholm Sweden
Website:	www.environdec.com
E-mail:	info@environdec.com

Accountabilities for PCR and independent, third-party verification
Product Category Rules (PCR)
CEN standard EN 15804 serves as the Core Product Category Rules (PCR)
Product Category Rules (PCR): Construction Products, 2019:14, version 1.3.4 and c-PCR-027 Fan coils (c-PCR to PCR 2019:14)
PCR review was conducted by: Technical Committee of the International EPD® System. The review panel may be contacted via info@environdec.com c-PCR review was conducted by: Gorka Benito Alonso
Third-party verification
Independent third-party verification of the declaration and data, according to ISO 14025:2006, via: <input checked="" type="checkbox"/> EPD verification by individual verifier Third-party verifier: Guido Croce Approved by: The International EPD® System
Procedure for follow-up of data during EPD validity involves third party verifier: <input type="checkbox"/> Yes <input checked="" type="checkbox"/> No

The EPD owner has the sole ownership, liability, and responsibility for the EPD.

EPDs within the same product category but registered in different EPD programmes, or not compliant with EN 15804, may not be comparable. For two EPDs to be comparable, they must be based on the same PCR (including the same version number) or be based on fully-aligned PCRs or versions of PCRs; cover products with identical functions, technical performances and use (e.g. identical declared/functional units); have equivalent system boundaries and descriptions of data; apply equivalent data quality requirements, methods of data collection, and allocation methods; apply identical cut-off rules and impact assessment methods (including the same version of characterisation factors); have equivalent content declarations; and be valid at the time of comparison. For further information about comparability, see EN 15804 and ISO 14025.

About Sabiana S.p.A

Sabiana is an Italian manufacturer of heating and air conditioning products, leader for hydronic terminal fan coil unit.

Founded in 1929 in Milan, from 2014 is part of the Arbonia Group, a group listed on the SIX Swiss Exchange, global force in the building components sector, operating actively in over 70 countries and maintains major manufacturing facilities in Italy, Switzerland, Germany, the Czech Republic, Poland, Serbia and Belgium.

Sabiana headquarter is located in Corbetta (MI) and production facilities are all located nearby: two sites in Corbetta (MI) and two sites in Magenta (MI).

Sabiana's continuous innovation and quality enhancement strategy is pursued by the continuous R&D investments, with the adoption of advanced 3D design and simulations and modern laboratories for product testing and inspection, by continuous investments on advanced production equipment and new technologies and by the implementation of IoT across the organization.

Strong commitment to quality and sustainability is witnessed by the long-held ISO 9001 certification of the company and the ISO 14001 certification of the main production sites.

Sustainability and Circular Economy became pillars of the company strategy, with the main results¹ of:

- 96.6% of production material sourced from the European Union (of which 83.6% from Italian suppliers, most of them located in a short distance)
- Self-production of 60% of the overall electrical energy consumption, with the target of 80% in few years
- Continuous increase of % of reusable and recyclable materials in production

The Plants

Name and location of production site(s):

Sabiana plants involved in the production process of fan coils are:

Sabiana 1: via Piave 53, 20011 Corbetta (MI), Italy

Sabiana 2 and 3: via Virgilio 2, 20013 Magenta (MI), Italy



Aerial view of Sabiana headquarter

¹ Referred to 2022

Product information

Product name: Fan Coils Carisma CRC-ECM

Product identification: Hydronic Fan Coil Unit (FCU) is defined as a factory-made single assembly, which provides one or more of the functions of forced circulation of air, heating, cooling, dehumidification and filtering of air, but which does not include the source of heating or cooling. This device includes at least a liquid-to-air heat exchanger and a fan and may be designed for free or ducted intake air and/or for free or ducted delivery of supply air. (BS EN 1397:2021).

Geographical scope: A1-A2 Global, A3 Italian, A4-A5, B, C European

UN CPC code: UN CPC Code: 43912 and HS 2007 8415.83

Product description:

CRC-ECM range includes 5 sizes (from 115 to 1395 m³/h) and 5 versions (for wall and ceiling installation, with casing and concealed), each equipped with 3 or 4 row coil and with the possibility to add a 1 or 2 row coil for 4 pipe systems. This is the series with the lowest electrical consumption in relation to both heat performance as well as working static performance and is particularly suited to satisfying the strictest energy consumption needs of class A buildings, and to ensuring excellent acoustic comfort.


The Carisma CRC-ECM fan coils combine a beautiful design with very interesting performances in terms of sound level and energy consumption.

The ECM range makes use of the excellent experience gained with the Cassette fan coil units with inverter board, first in the world in production since 2009, and which have had great success on all markets.

The innovative brushless and sensorless type synchronous electronic motor with permanent magnets, is controlled by an inverter board designed and developed in Italy.

The air flow rate can be varied in continuous by means of a 1-10 V signal generated by Sabiana controls or by independent control systems. The continuous air flow control improves the acoustic comfort and allows a more punctual reply to the variation of the thermal loads and a greater stability of the requested ambient temperature. The extreme efficiency, also at a low speed, makes possible a great reduction in electric consumption (more than 50% less in comparison to the though efficient motor of the Carisma CRC range), with absorption values, under normal operating conditions, that do not exceed 16 Watt for the CRC-ECM models.

Each size available in two models: with cabinet (MV for vertical installation / MO for horizontal installation) or without cabinet Vertical and Horizontal Concealed Installation (IV/IO for horizontal or vertical concealed installation). From a functional point of view (energy performance) the two models coincide, as the casing does not influence performance.

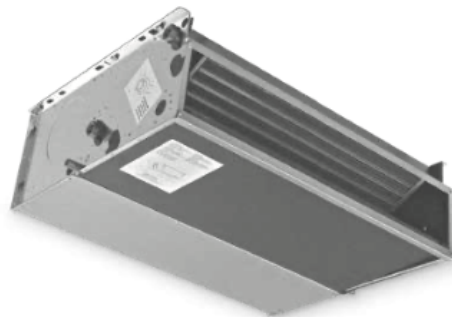

The present EPD covers the 25 sizes of Fan Coils CRC-ECM shown in the following table and it is applicable to all possible configurations (MV/MO/MVB/IV/IO).

N°	Model	TYPE	TUBE SYSTEM
1	CRC-ECM 23	Non Ducted Fan Coil	2-pipe
2	CRC-ECM 24	Non Ducted Fan Coil	2-pipe
3	CRC-ECM 43	Non Ducted Fan Coil	2-pipe
4	CRC-ECM 44	Non Ducted Fan Coil	2-pipe
5	CRC-ECM 63	Non Ducted Fan Coil	2-pipe
6	CRC-ECM 64	Non Ducted Fan Coil	2-pipe
7	CRC-ECM 73	Non Ducted Fan Coil	2-pipe
8	CRC-ECM 74	Non Ducted Fan Coil	2-pipe
9	CRC-ECM 93	Non Ducted Fan Coil	2-pipe
10	CRC-ECM 94	Non Ducted Fan Coil	2-pipe
11	CRC-ECM 23+1	Non Ducted Fan Coil	4-pipe
12	CRC-ECM 23+2	Non Ducted Fan Coil	4-pipe
13	CRC-ECM 24+1	Non Ducted Fan Coil	4-pipe
14	CRC-ECM 43+1	Non Ducted Fan Coil	4-pipe

15	CRC-ECM 43+2	Non Ducted Fan Coil	4-pipe
16	CRC-ECM 44+1	Non Ducted Fan Coil	4-pipe
17	CRC-ECM 63+1	Non Ducted Fan Coil	4-pipe
18	CRC-ECM 63+2	Non Ducted Fan Coil	4-pipe
19	CRC-ECM 64+1	Non Ducted Fan Coil	4-pipe
20	CRC-ECM 73+1	Non Ducted Fan Coil	4-pipe
21	CRC-ECM 73+2	Non Ducted Fan Coil	4-pipe
22	CRC-ECM 74+1	Non Ducted Fan Coil	4-pipe
23	CRC-ECM 93+1	Non Ducted Fan Coil	4-pipe
24	CRC-ECM 93+2	Non Ducted Fan Coil	4-pipe
25	CRC-ECM 94+1	Non Ducted Fan Coil	4-pipe

According to the General Programme Instruction (GPI) v. 4.0 and the PCR 2019:14 "Construction products" v.1.3.4, the results for each category of impact are represented for the product CRC-ECM 43 MV/MO, identified as representative. This product is the model of the CRC-ECM range with the highest sales volumes.

Technical data

Sabiana Fan Coils are certified Eurovent (Certificate n-96.01.182), European organization which tests and certifies that

performance and technical characteristics of air conditioning products are fully compliant with manufacturer's claims.

3 row coil – 2 pipe units:

COOLING (summer mode)

Entering air temperature: +27°C d.b. +19°C w.b.
 Water temperature: +7°C E.W.T. +12°C L.W.T.

HEATING (winter mode)

Entering air temperature: +20°C
 Water temperature: +45 °C E.W.T. +40 °C L.W.T.

MODEL		CRC-ECM 23			CRC-ECM 43			CRC-ECM 63		
		1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX
Volt										
Speed										
Air flow (E)	m ³ /h	120	220	330	210	350	515	305	495	735
Cooling total capacity (E)	kW	0,73	1,18	1,59	1,41	2,18	2,95	1,96	2,93	3,96
Cooling sensible capacity (E)	kW	0,55	0,92	1,28	1,03	1,64	2,26	1,46	2,22	3,08
Heating capacity (E)	kW	0,77	1,29	1,80	1,42	2,26	3,14	1,96	3,00	4,14
Fan Power input (E)	W	7,0	11,0	21,0	6,0	12,0	25,0	7,0	15,0	32,0

(E) = Eurovent certified performance

MODEL		CRC-ECM 73			CRC-ECM 93		
Volt Speed		1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX
Air flow (E)	m ³ /h	400	610	890	605	945	1395
Cooling total capacity (E)	kW	2,60	3,68	4,94	3,45	4,82	6,26
Cooling sensible capacity (E)	kW	1,92	2,77	3,80	2,63	3,79	5,10
Heating capacity (E)	kW	2,56	3,72	5,08	3,74	5,41	7,38
Fan Power input (E)	W	9,0	18,5	41	16	41,0	99,0

(E) = Eurovent certified performance

4 row coil – 2 pipe units:

COOLING (summer mode)

Entering air temperature: +27°C d.b. +19°C w.b.

Water temperature: + 7°C E.W.T. +12°C L.W.T.

HEATING (winter mode)

Entering air temperature: +20°C

Water temperature: +45 °C E.W.T. +40 °C L.W.T.

MODEL		CRC-ECM 24			CRC-ECM 44			CRC-ECM 64		
Volt Speed		1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX
Air flow (E)	m ³ /h	115	210	325	200	340	505	290	475	720
Cooling total capacity (E)	kW	0,77	1,32	1,86	1,43	2,27	3,17	2,05	3,19	4,51
Cooling sensible capacity (E)	kW	0,56	0,98	1,42	1,03	1,67	2,39	1,48	2,34	3,38
Heating capacity (E)	kW	0,78	1,37	1,98	1,42	2,30	3,32	2,02	3,23	4,68
Fan Power input (E)	W	7,0	11,0	21,0	6,0	12,0	25,0	7,0	15,0	32,0

(E) = Eurovent certified performance

MODEL		CRC-ECM 74			CRC-ECM 94		
Volt Speed		1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX
Air flow (E)	m ³ /h	380	585	875	575	910	1365
Cooling total capacity (E)	kW	2,61	3,82	5,30	3,59	5,21	7,04
Cooling sensible capacity (E)	kW	1,90	2,82	3,99	2,69	3,99	5,53
Heating capacity (E)	kW	2,57	3,84	5,43	3,76	5,63	7,93
Fan Power input (E)	W	9,0	18,5	41	16	41,0	99,0

(E) = Eurovent certified performance

3+1 row coil – 4 pipe units:

COOLING (summer mode)

Entering air temperature: +27°C d.b. +19°C w.b.

Water temperature: +7°C E.W.T. +12°C L.W.T.

HEATING (winter mode)

Entering air temperature: +20°C

Water temperature: +65 °C E.W.T. +55 °C L.W.T.

MODEL		CRC-ECM 23+1			CRC-ECM 43+1			CRC-ECM 63+1		
Volt Speed		1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX
Air flow (E)	m ³ /h	120	220	330	210	350	515	305	495	735
Cooling total capacity (E)	kW	0,73	1,18	1,59	1,41	2,18	2,95	1,96	2,93	3,96
Cooling sensible capacity (E)	kW	0,55	0,92	1,28	1,03	1,64	2,26	1,46	2,22	3,08
Heating capacity (E)	kW	0,71	1,08	1,43	1,29	1,85	2,41	1,76	2,45	3,22
Fan Power input (E)	W	7,0	11,0	21,0	6,0	12,0	25,0	7,0	15,0	32,0

(E) = Eurovent certified performance

MODEL		CRC-ECM 73+1			CRC-ECM 93+1		
Volt Speed		1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX
Air flow (E)	m ³ /h	400	610	890	605	945	1395
Cooling total capacity (E)	kW	2,60	3,68	4,94	3,45	4,82	6,26
Cooling sensible capacity (E)	kW	1,92	2,77	3,80	2,63	3,79	5,10
Heating capacity (E)	kW	2,33	3,12	4,06	2,99	4,05	5,24
Fan Power input (E)	W	9,0	18,5	41	16*	41,0*	99,0*

(E) = Eurovent certified performance. *Fan Power Input in heating conditions: MIN: 18W; MED: 46W; MAX: 111W.

4+1 row coil – 4 pipe units:

COOLING (summer mode)

Entering air temperature: +27°C d.b. +19°C w.b.

Water temperature: +7°C E.W.T. +12°C L.W.T.

HEATING (winter mode)

Entering air temperature: +20°C

Water temperature: +65 °C E.W.T. +55 °C L.W.T.

MODEL		CRC-ECM 24+1			CRC-ECM 44+1			CRC-ECM 64+1		
Volt Speed		1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX
Air flow	m ³ /h	115	210	325	200	340	505	290	475	720
Cooling total capacity	kW	0,77	1,32	1,86	1,43	2,27	3,17	2,05	3,19	4,51
Cooling sensible capacity	kW	0,56	0,98	1,42	1,03	1,67	2,39	1,48	2,34	3,38
Heating capacity	kW	0,71	1,08	1,43	1,29	1,85	2,41	1,76	2,45	3,22
Fan Power input	W	7,0	11,0	21,0	6,0	12,0	25,0	7,0	15,0	32,0

MODEL		CRC-ECM 74+1			CRC-ECM 94+1		
Volt Speed		1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX
Air flow	m ³ /h	380	585	875	575	910	1365
Cooling total capacity	kW	2,61	3,82	5,30	3,59	5,21	7,04
Cooling sensible capacity	kW	1,90	2,82	3,99	2,69	3,99	5,53
Heating capacity	kW	2,33	3,12	4,06	2,99	4,05	5,24
Fan Power input	W	9,0	18,5	41	16	41,0	99,0

3+2 row coil – 4 pipe units:

COOLING (summer mode)

Entering air temperature: +27°C d.b. +19°C w.b.

Water temperature: +7°C E.W.T. +12°C L.W.T.

HEATING (winter mode)

Entering air temperature: +20°C.

Water temperature: +65 °C E.W.T. +55 °C L.W.T.

MODEL		CRC-ECM 23+2			CRC-ECM 43+2			CRC-ECM 63+2		
Volt Speed		1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX
Air flow	m ³ /h	120	220	330	210	350	515	305	495	735
Cooling total capacity	kW	0,73	1,18	1,59	1,41	2,18	2,95	1,96	2,93	3,96
Cooling sensible capacity	kW	0,55	0,92	1,28	1,03	1,64	2,26	1,46	2,22	3,08
Heating capacity	kW	1.13	1.81	2.48	1.94	2.9	3.9	2.83	4.14	5.63
Fan Power input	W	7,0	11,0	21,0	6,0	12,0	25,0	7,0	15,0	32,0

MODEL		CRC-ECM 73+2			CRC-ECM 93+2		
Volt Speed		1 MIN	5 MED	10 MAX	1 MIN	5 MED	10 MAX
Air flow	m ³ /h	400	610	890	605	945	1395
Cooling total capacity	kW	2,60	3,68	4,94	3,45	4,82	6,26
Cooling sensible capacity	kW	1,92	2,77	3,80	2,63	3,79	5,10
Heating capacity	kW	3.72	5.2	7.01	5.12	7.22	9.6
Fan Power input	W	9,0	18,5	41	16	41,0	99,0

Fan Coils are sold in cardboard boxes placed on wood pallets and wrapped in plastic film. The following table shows the conversion factors to determine the weight of the of the various fan coil models compared to the representative model CRC-ECM 43 MV/MO.

For IV/IO models, the conversion factors are calculated with respect to CRC-ECM 43 IV/IO.

MODEL	DIMENSIONS MM		UNPACKED UNIT WEIGHT (kg)		PACKED UNIT WEIGHT (kg)		UNPACKED UNIT CONVERSION FACTORS		PACKED UNIT CONVERSION FACTORS	
	MV/MO	IV/IO	MV/MO	IV/IO	MV/MO	IV/IO	MV/MO	IV/IO	MV/MO	IV/IO
CRC-ECM 23	770x225x530	454x218x511	15,4	11,8	17,8	14,2	0,76	0,72	0,76	0,76
CRC-ECM 24	770x225x530	454x218x511	16,2	12,6	18,6	15,0	0,80	0,77	0,80	0,80
CRC-ECM 43	985x225x530	669x218x511	20,2	16,3	23,2	18,8	1,00	1,00	1,00	1,00
CRC-ECM 44	985x225x530	669x218x511	21,2	17,3	24,2	19,8	1,05	1,06	1,05	1,05
CRC-ECM 63	1200x225x530	884x218x511	24,9	20,5	28,5	23,6	1,23	1,26	1,23	1,26
CRC-ECM 64	1200x225x530	884x218x511	26,2	21,8	29,8	24,9	1,30	1,34	1,30	1,33
CRC-ECM 73	1415x225x530	1099x218x511	28,8	24,2	33,2	28,1	1,43	1,48	1,43	1,50
CRC-ECM 74	1415x225x530	1099x218x511	30,3	25,7	34,7	29,6	1,50	1,58	1,50	1,58
CRC-ECM 93	1415x255x530	1099x248x511	32,2	27,3	37,0	31,5	1,59	1,67	1,59	1,68
CRC-ECM 94	1415x255x530	1099x248x511	33,7	28,8	38,5	33,0	1,67	1,77	1,67	1,76
CRC-ECM 23+1	770x225x530	454x218x511	16,2	12,6	18,6	15,0	0,80	0,77	0,80	0,80
CRC-ECM 23+2	770x225x530	454x218x511	16,8	13,2	19,2	15,61	0,83	0,81	0,83	0,83
CRC-ECM 24+1	770x225x530	454x218x511	17,0	13,4	19,4	5,8	0,84	0,82	0,84	0,84
CRC-ECM 43+1	985x225x530	669x218x511	21,4	17,5	24,4	20,0	1,06	1,07	1,05	1,06
CRC-ECM 43+2	985x225x530	669x218x511	22,1	18,2	25,1	20,7	1,09	1,12	1,08	1,10
CRC-ECM 44+1	985x225x530	669x218x511	22,4	18,5	25,4	21,0	1,11	1,13	1,09	1,12
CRC-ECM 63+1	1200x225x530	884x218x511	26,4	22,0	22,8	25,1	1,31	1,35	1,29	1,34
CRC-ECM 63+2	1200x225x530	884x218x511	27,3	22,9	23,9	26,0	1,35	1,40	1,33	1,38
CRC-ECM 64+1	1200x225x530	884x218x511	27,7	23,3	24,1	26,4	1,37	1,43	1,35	1,41
CRC-ECM 73+1	1415x225x530	1099x218x511	30,6	26,0	35,0	29,9	1,51	1,60	1,51	1,59
CRC-ECM 73+2	1415x225x530	1099x218x511	31,7	27,1	36,1	31,0	1,57	1,66	1,56	1,65
CRC-ECM 74+1	1415x225x530	1099x218x511	32,1	27,5	36,5	31,4	1,59	1,69	1,58	1,67
CRC-ECM 93+1	1415x255x530	1099x248x511	34,0	29,1	38,2	33,3	1,68	1,79	1,68	1,77
CRC-ECM 93+2	1415x255x530	1099x248x511	35,1	30,2	39,9	34,2	1,74	1,85	1,72	1,83
CRC-ECM 94+1	1415x255x530	1099x248x511	35,5	30,5	40,3	34,8	1,76	1,87	1,74	1,85

Content information

The ranges of products from Sabiana Spa comply with the requirements of the "RoHS" Directive (EU) 2015/863 of 31 March 2015 and 2011/65/EU of 8 June 2011.

Sabiana S.p.A fulfils the requirements of "Regulation (EC) No 1907/2006 - Registration,

Evaluation, Authorisation and Restriction Chemicals (REACH)". Detailed declaration of the SVHC substances that may be present above a concentration of 0.1% (w/w) in the individual articles is available.

Product components (unit)	Weight, kg	Post-consumer recycled material, weight-%	Pre-consumer recycled material, weight-%	Total recycled material, weight-%	Biogenic material, weight-% and kg C/kg
Sheet metal	7,8615	0	0	0	0 resp. 0
Steel	3,8123	0	0	0	0 resp. 0
ABS	2,6130	0	0	0	0 resp. 0
Aluminium	2,1805	13,69	4,25	17,94	0 resp. 0
Copper	1,7823	11,88	0	11,88	0 resp. 0
Iron	1,6716	0	0	0	0 resp. 0
Ferrite	0,1570	0	0	0	0 resp. 0
PS	0,1500	0	0	0	0 resp. 0
Brass	0,1215	0	0	0	0 resp. 0
Electronic components	0,1000	0	0	0	0 resp. 0
PVC	0,0704	0	0	0	0 resp. 0
Nylon	0,0434	0	0	0	0 resp. 0
Rubber	0,0320	0	0	0	0 resp. 0
Bronze	0,0280	0	0	0	0 resp. 0
PE	0,0200	0	0	0	0 resp. 0
Polyurethane	0,0120	0	0	0	0 resp. 0
Mylar	0,0120	0	0	0	0 resp. 0
Fiberglass	0,0045	0	0	0	0 resp. 0
Paper	0,0020	0	0	0	0 resp. 0
TOTAL	20,67	2,47	0,45	2,92	0 resp. 0
Packaging materials	Weight, kg	Weight-% (versus the product)		Weight biogenic carbon, kg C/kg	
Cardboard	1,9800	9,58		0 resp. 0	
Wood (pallet)	0,6429	3,11		0 resp. 0	
Paper	0,0780	0,38		0 resp. 0	
LDPE	0,0586	0,28		0 resp. 0	
PS	0,0010	0,00		0 resp. 0	
TOTAL	2,76	13,35		0 resp. 0	

Data referred to a single unit of the representative product Carisma CRC-ECM 43 MV/MO. Note: The share of biobased/recycled material is unknown so, in accordance with PCR 2019:14 v.1.3.4, this part of the content declaration is declared as 0% (a conservative estimate).

LCA information

Methodology: The quantification of the environmental performance was carried out in accordance with the Life Cycle Assessment (LCA - Life Cycle Assessment) methodology regulated by the ISO 14040, ISO 14044 and ISO 14025 standards and following the specific

product requirements PCR 2019: 14 Construction Products Version 1.3.4 and c-PCR 027 Fan coils.

The LCA methodology allows you to determine the environmental impacts of a product or service in terms of resource consumption and

emissions into the environment, as well as waste production, from a life cycle perspective.

Functional unit: The functional unit is 1 kWh of thermal energy exchanged with the air of the room in cooling and/or heating mode by a heating/cooling equipment using small scale HVAC as defined in CPC 43912 and HS 8415.83 and, specifically, using an Hydronic Fan Coil Unit as defined into EN1397. The environmental impacts are given per functional unit.

Reference service life: The lifetime for fan coil is considered to be 20 years.

Time representativeness: The LCA study is conducted in 2024 with data relating to 2023.

Database and LCA software: The Ecoinvent database v.3.10 (www.ecoinvent.org) provides the life cycle inventory data for the raw and process materials obtained from the background system. LCA software used is SimaPro 9.6.

Cut-off rules: 1% cut-off is applied. According to PCR 2019:14 v.1.3.4, data for elementary flows to and from the product system contributing to a minimum of 99% of the declared environmental impacts have been included.

Quality data: Specific data are used for raw materials, electricity, fuel data, emissions, waste data, average distances and means of transport in modules A2 and A4.

Selected generic data derived from the Ecoinvent v.3.10 database are used for the

following phases: production of raw materials, fuels and electricity.

Proxy data do not contribute to the potential environmental impacts by more than 10% for each impact category.

Allocation rules: No allocation was made in the A1-A2 modules. The materials and weights were extracted from the BoM. For each material, the type of packaging with which it arrives at the Sabiana plant has been identified and the amount of packaging allocated to the individual material has been calculated. Raw material transports were calculated based on manufacturer/supplier distances. For module A3 an allocation was made based on the number of pieces to determine the specific consumes of a fan coil. In particular, in the Sabiana 1 plant, where the production of the batteries takes place (fan coil component), where possible, we tried to avoid allocation otherwise the total consumption of the battery department was allocated by number of batteries produced. In the Sabiana 2 and Sabiana 3 plants, all consumption and outputs were allocated on the basis of the parts produced and the pieces handled respectively.

Environmental impact method: EN 15804 + A2 based on EF 3.1 characterisation factors ([JRC Website](#))

Description of the system boundaries: Cradle to grave and module D (A + B + C + D).

Modules declared, geographical scope, share of specific data (in GWP-GHG results) and data variation (in GWP-GHG results):

	Product stage			Construction process stage			Use stage							End of life stage			Resource recovery stage
	Raw material supply	Transport	Manufacturing	Transport	Construction installation	Use	Maintenance	Repair	Replacement	Refurbishment	Operational energy use	Operational water use	De-construction demolition	Transport	Waste processing	Disposal	Reuse-Recovery-Recycling-potential
Module	A1	A2	A3	A4	A5	B1	B2	B3	B4	B5	B6	B7	C1	C2	C3	C4	D
Modules declared	X	X	X	X	X	ND	X	X	X	ND	X	ND	X	X	X	X	X
Geography	GLO	GLO	IT	EU	EU	-	EU	EU	EU	-	EU	-	EU	EU	EU	EU	EU
Specific data used	>90%					-	-	-	-	-	-	-	-	-	-	-	-
Variation – products	-48/+34%																
Variation – sites	0%			-	-	-	-	-	-	-	-	-	-	-	-	-	-

X=Declared module, ND= Non declared, EU=European, GLO=Global, IT=Italy. For module B. only B2 and B6 are applicable for fan coils usage (according to c-PCR-027 Fan coils).

The following table shows the range of variability for each module and for each

category of impact. These values are required by PCR 2019:14 v.1.3.4 for EPD of multiple products with variances greater than 10%.

Module	A1-A3	A4	A5	B2	B3	B4	B6	C1	C2	C3	C4	D
GWP-GWP	-48/+34%	-42/+58%	-45/+58%	0%	0%	0%	-30/+103%	0%	-43/+58%	-42/+58%	-69/+58%	-44/+58%
GWP-total	-48/+34%	-42/+58%	-45/+58%	0%	0%	0%	-30/+103%	0%	-43/+58%	-42/+58%	-69/+58%	-42/+58%
ODP	-37/+33%	-42/+58%	-42/+58%	0%	0%	0%	-30/+103%	0%	-43/+58%	-42/+58%	-42/+58%	-42/+58%
AP	-31/+35%	-42/+58%	-42/+58%	0%	0%	0%	-30/+103%	0%	-43/+58%	-42/+58%	-47/+58%	-42/+58%
EP-freshwater	-31/+35%	-42/+58%	-42/+58%	0%	0%	0%	-30/+103%	0%	-43/+58%	-42/+58%	-42/+58%	-42/+58%
EP-marine	-37/+34%	-42/+58%	-42/+58%	0%	0%	0%	-30/+103%	0%	-43/+58%	-42/+58%	-41/+58%	-42/+58%
EP-terrestrial	-36/+34%	-42/+58%	-42/+58%	0%	0%	0%	-30/+103%	0%	-43/+58%	-42/+58%	-48/+58%	-42/+58%
POCP	-37/+34%	-42/+58%	-42/+58%	0%	0%	0%	-30/+103%	0%	-43/+58%	-42/+58%	-46/+58%	-42/+58%
ADP-minerals&metals	-27/+35%	-42/+58%	-42/+58%	0%	0%	0%	-30/+103%	0%	-43/+58%	-42/+58%	-42/+58%	-42/+58%
ADP-fossil	-39/+34%	-42/+58%	-42/+58%	0%	0%	0%	-30/+103%	0%	-43/+58%	-42/+58%	-42/+58%	-43/+58%
WDP	-42/+34%	-42/+58%	-42/+58%	0%	0%	0%	-30/+103%	0%	-42/+58%	-42/+58%	-42/+58%	-49/+58%

Life Cycle Stages

A1, raw material supply. This includes the extraction and processing of all raw materials and energy which occur upstream from the manufacturing process.

A2, transport to the manufacturer. The raw materials are transported to the manufacturing site. The modelling includes road and boat transportations of each raw material. For each component/material, the distance from the

production country to the Sabiana plant has been calculated. For non-European materials, the transportation from the production plants to the port of origin has been deemed irrelevant compared to the distance that the product needs to travel by ship. For the components/materials coming from countries outside Europe but unknown, a distance on ship of 10000 km and a distance of 165 km on road (from the port of Genoa to Sabiana) have been assumed.

A3, manufacturing. This module includes the manufacture/assembly of product at the Sabiana' plants and the manufacture of packaging. The production of packaging material is taken into account at this stage. The processing of any waste arising from this stage is also included. The 25,9% of the electricity used for the production of the Carisma CRC-ECM 43 fan coil at Sabiana plants is self-produced by photovoltaic panels. The remaining amount of electricity is supplied by the national grid. The electrical mix used to model the electrical consumption at medium voltage is based on the Italian Residual Mix 2023 (Source: AIB, "European Residual Mixes - Results of the calculation of Residual Mixes for the calendar year 2023", 642 gCO₂eq/ kWh). The end-of-life scenario for raw material packaging was modelled according to CONAI 2023 data (Italian Packaging Consortium).

A4, transport to the building site. This module includes transport from the production gate to the installation site. The average distribution distance is calculated based on the sales of the CRC-ECM 43 model in the year 2023. Specifically, the following distribution is considered: 76% of the product is sold in Italy and 24% in other European countries (it was considered the specific distance for each state). Shipments to Italy and Europe took place by truck, with some distances also covered by train (for the United Kingdom).

A5, installation into the building. This module includes all material and energy inputs and outputs required for the installation of the fan coil. The installation starts manually without the use of energy. Specifically, this module includes the end of life of the product packaging and the

consumption of water for battery recharge. The end-of-life scenario for packaging was modelled for an European scenario according to the PCR Part A for Building-Related Products and Services v.4 of UL Environment framework.

B1, use. This module includes the use of the installed product in terms of any emissions released into the environment during its lifetime (not covered by B2-B7). According to the PCR, this module is not declared as it is not relevant for the product.

B2, maintenance, B3, repair, B4, replacement. As indicated by the manufacturer, no maintenance, repair, replacement action is required during the lifetime of 20 years. Any exceptional events are not considered in this study.

B5, refurbishment. According to the PCR, this module is not declared as it is not relevant for the product.

B6, operational energy use. This module includes the energy consumption from the operation of the fan coil unit. The total electrical energy consumption along FCU lifetime is been calculated according to the Technical Certification Rules Of The Eurovent Certified Performance Mark with the following hypotheses:

- 1100 hours in summer 65% (LS) 30% (MS) 5% (HS)
- 1500 hours in winter 70% (LS) 25% (MS) 5% (HS)

where:

LS=Low Speed

MS=Medium Speed

HS=High Speed

An average European electric mix (*Electricity, low voltage {RER} market group for electricity, low voltage | Cut-off, U, 303 g CO₂eq/ kWh*), was considered in the modelling as the product is mainly sold in Europe and the sales distribution from country to country varies significantly from year to year. In the "Additional environmental information" section, the B6

module is reported for different scenarios, based on the country where the fan coil is used.

C1 - de-construction. This stage includes the impacts during the dismantling of the CRC- ECM fan coil from the building. It is assumed that no energy and additional material are needed for the dismantling of the product. This module has a contribution of 0 to all environmental indicators.


C2, waste transport. This stage includes the transportation of discarded products to the waste processing/disposal area. 50 km distance by trucks is assumed.

C3, waste processing. This module includes the collection of waste fractions from the deconstruction and waste processing of material flows intended for

reuse, recycling and energy recovery. For Europe, it is assumed a material recycling rate of 50% according to PCR Part A for Building-Related Products and Services v.4 of UL Environment framework.

C4, waste disposal. Waste disposal including physical pre-treatment and management of the disposal site. According to PCR Part A for Building-Related Products and Services v.4 of UL Environment framework, for Europe it is assumed the following scenario: a 37% in landfill and 13% in incineration. No energy recovery is considered.

D, reuse, recycling and energy recovery potentials. Materials that are recycled are assumed to substitute the use of virgin metals. Benefits of heat recovery from the incineration are excluded.

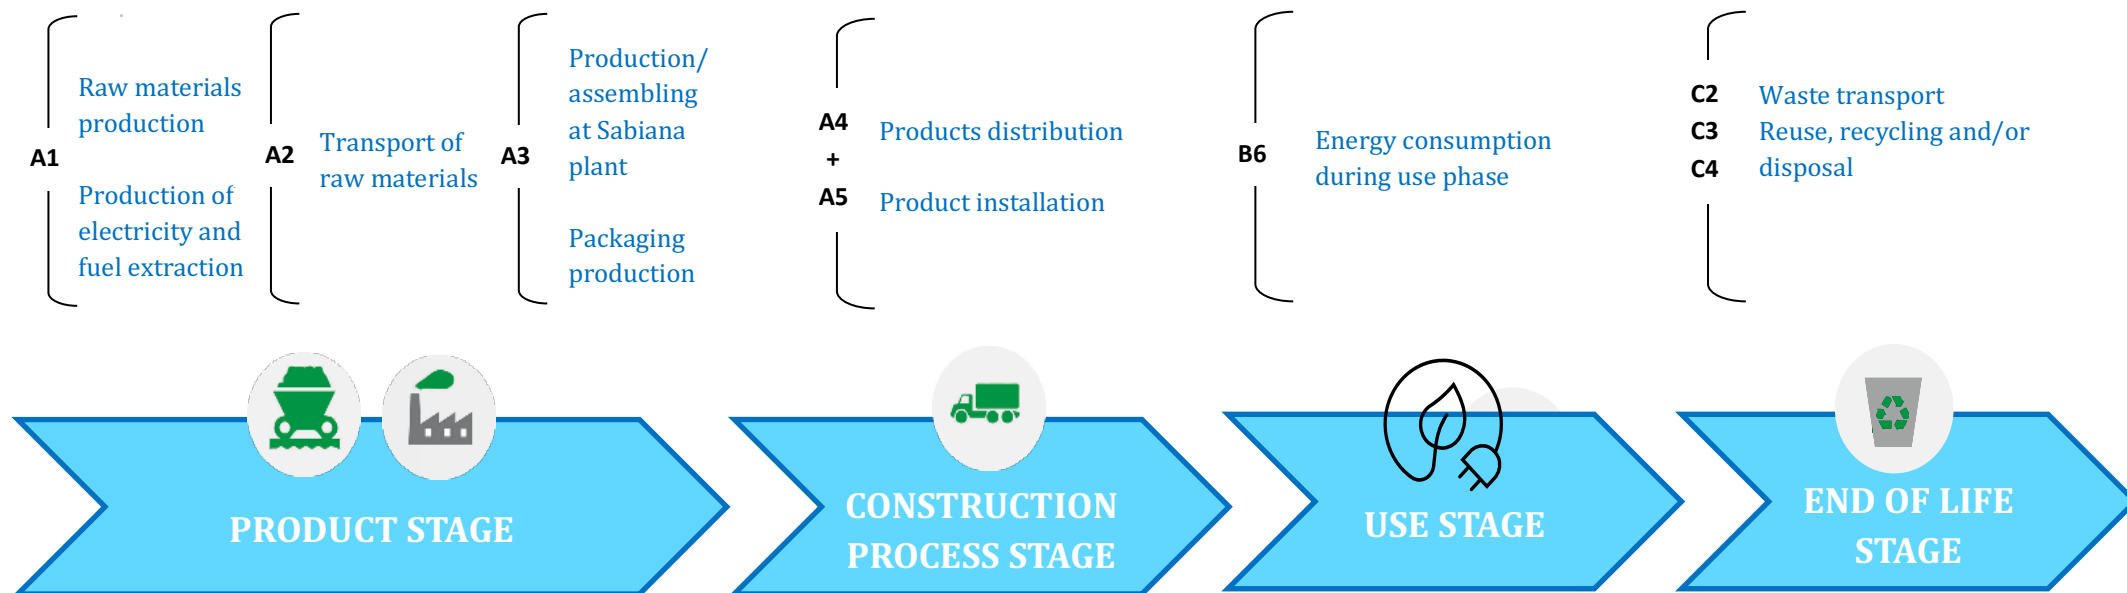

Results of the environmental performance indicators

Mandatory impact category indicators according to EN 15804

Results referred to 1 kWh of thermal energy exchanged with the air of the room in cooling and/or heating mode (CRC-ECM 43 MV/MO, representative model)													
Indicator	Unit	A1-A3	A4	A5	B2	B3	B4	B6	C1	C2	C3	C4	D
GWP-fossil	kg CO ₂ eq.	1,39E-03	1,85E-05	7,03E-07	0	0	0	1,51E-03	0	2,29E-06	5,90E-07	1,25E-05	-3,12E-04
GWP-biogenic	kg CO ₂ eq.	1,54E-05	6,06E-09	3,29E-05	0	0	0	5,95E-05	0	7,43E-10	1,40E-10	3,78E-07	1,76E-05
GWP-luluc	kg CO ₂ eq.	5,01E-06	4,54E-10	1,75E-11	0	0	0	4,78E-06	0	5,57E-11	1,47E-11	9,59E-11	-1,49E-06
GWP-total	kg CO ₂ eq.	1,41E-03	1,85E-05	1,72E-05	0	0	0	1,57E-03	0	2,29E-06	5,90E-07	1,28E-05	-2,96E-04
ODP	kg CFC 11 eq.	1,90E-11	3,77E-13	8,13E-15	0	0	0	2,38E-11	0	4,63E-14	3,67E-16	2,10E-14	-4,84E-12
AP	mol H ⁺ eq.	1,58E-05	4,61E-08	1,21E-09	0	0	0	7,55E-06	0	5,49E-09	2,02E-10	7,80E-09	-5,19E-06
EP-freshwater	kg P eq.	1,01E-07	1,55E-11	7,06E-13	0	0	0	1,47E-07	0	1,90E-12	5,29E-13	7,21E-12	-2,97E-08
EP-marine	kg N eq.	1,53E-06	1,77E-08	6,03E-10	0	0	0	9,75E-07	0	2,08E-09	9,09E-11	4,48E-09	-3,97E-07
EP-terrestrial	mol N eq.	1,83E-05	1,93E-07	5,36E-09	0	0	0	1,10E-05	0	2,28E-08	9,24E-10	3,68E-08	-5,03E-06
POCP	kg NMVOC eq.	6,28E-06	8,04E-08	2,19E-09	0	0	0	3,66E-06	0	9,61E-09	2,39E-10	1,13E-08	-1,73E-06
ADP-minerals&metals*	kg Sb eq.	1,82E-07	6,11E-13	3,98E-14	0	0	0	9,43E-11	0	7,50E-14	7,36E-15	2,16E-13	-6,64E-08
ADP-fossil*	MJ	8,01E-03	2,46E-06	1,20E-07	0	0	0	2,66E-02	0	3,00E-07	8,65E-08	1,03E-06	-1,79E-03
WDP*	m ³ eq	6,02E-04	1,04E-07	4,06E-07	0	0	0	3,97E-04	0	1,27E-08	1,95E-08	-1,07E-06	-1,48E-04
Acronyms	GWP-fossil = Global Warming Potential fossil fuels; GWP-biogenic = Global Warming Potential biogenic; GWP-luluc = Global Warming Potential land use and land use change; ODP = Depletion potential of the stratospheric ozone layer; AP = Acidification potential, Accumulated Exceedance; EP-freshwater = Eutrophication potential, fraction of nutrients reaching freshwater end compartment; EP-marine = Eutrophication potential, fraction of nutrients reaching marine end compartment; EP-terrestrial = Eutrophication potential, Accumulated Exceedance; POCP = Formation potential of tropospheric ozone; ADP-minerals&metals = Abiotic depletion potential for non-fossil resources; ADP-fossil = Abiotic depletion for fossil resources potential; WDP = Water (user) deprivation potential, deprivation-weighted water consumption												

* Disclaimer: The results of this environmental impact indicator shall be used with care as the uncertainties of these results are high or as there is limited experience with the indicator.

Additional mandatory and voluntary impact category indicators

Results referred to 1 kWh of thermal energy exchanged with the air of the room in cooling and/or heating mode (CRC-ECM 43 MV/MO, representative model)													
Indicator	Unit	A1-A3	A4	A5	B2	B3	B4	B6	C1	C2	C3	C4	D
GWP-GHG²	kg CO ₂ eq.	1,40E-03	1,85E-05	1,01E-06	0	0	0	1,52E-03	0	2,29E-06	5,90E-07	1,25E-05	-3,14E-04

² This indicator accounts for all greenhouse gases except biogenic carbon dioxide uptake and emissions and biogenic carbon stored in the product. As such, the indicator is identical to GWP-total except that the CF for biogenic CO₂ is set to zero.

Resource use indicators

Results referred to 1 kWh of thermal energy exchanged with the air of the room in cooling and/or heating mode (CRC-ECM 43 MV/MO, representative model)													
Indicator	Unit	A1-A3	A4	A5	B2	B3	B4	B6	C1	C2	C3	C4	D
PERE**	MJ	2,50E-03	7,59E-07	4,67E-08	0	0	0	8,99E-03	0	9,30E-08	1,47E-08	5,07E-07	-5,91E-04
PERM**	MJ	1,58E-03	1,07E-07	2,22E-04	0	0	0	1,19E-03	0	1,31E-08	1,69E-06	6,81E-08	-3,43E-04
PERT**	MJ	4,08E-03	8,65E-07	2,22E-04	0	0	0	1,02E-02	0	1,06E-07	1,71E-06	5,75E-07	-9,34E-04
PENRE	MJ	7,88E-03	2,45E-06	1,20E-07	0	0	0	2,65E-02	0	3,00E-07	8,65E-08	1,03E-06	-1,72E-03
PENRM	MJ	1,33E-04	6,46E-12	2,41E-12	0	0	0	2,16E-09	0	7,92E-13	4,17E-13	2,46E-11	-6,62E-05
PENRT	MJ	8,01E-03	2,45E-06	1,20E-07	0	0	0	2,65E-02	0	3,00E-07	8,65E-08	1,03E-06	-1,79E-03
SM	kg	2,25E-05	0	0	0	0	0	0	0	0	0	0	0
RSF	MJ	0	0	0	0	0	0	0	0	0	0	0	0
NRSF	MJ	0	0	0	0	0	0	0	0	0	0	0	0
FW	m ³	2,03E-05	6,27E-09	-1,30E-08	0	0	0	3,05E-05	0	7,68E-10	9,19E-10	-9,83E-08	-5,07E-06
Acronyms	PERE = Use of renewable primary energy excluding renewable primary energy resources used as raw materials; PERM = Use of renewable primary energy resources used as raw materials; PERT = Total use of renewable primary energy resources; PENRE = Use of non-renewable primary energy excluding non-renewable primary energy resources used as raw materials; PENRM = Use of non-renewable primary energy resources used as raw materials; PENRT = Total use of non-renewable primary energy re-sources; SM = Use of secondary material; RSF = Use of renewable secondary fuels; NRSF = Use of non-renewable secondary fuels; FW = Use of net fresh water												

** The indicators PERE, PERM and PERT were calculated according to method B of the Annex 3 (PCR 2019:14 v.1.3.4)

Waste indicators

Results referred to 1 kWh of thermal energy exchanged with the air of the room in cooling and/or heating mode (CRC-ECM 43 MV/MO, representative model)													
Indicator	Unit	A1-A3	A4	A5	B2	B3	B4	B6	C1	C2	C3	C4	D
Hazardous waste disposed	kg	3,90E-06	1,80E-09	3,58E-09	0	0	0	9,35E-07	0	2,21E-10	1,20E-08	1,82E-05	-1,16E-07
Non-hazardous waste disposed	kg	3,10E-05	7,26E-09	9,30E-06	0	0	0	2,02E-05	0	8,91E-10	2,60E-07	8,56E-05	-5,30E-06
Radioactive waste disposed	kg	2,60E-08	2,31E-11	1,04E-12	0	0	0	2,68E-07	0	2,81E-12	3,41E-13	7,84E-12	-5,57E-09

Output flow indicators

Results referred to 1 kWh of thermal energy exchanged with the air of the room in cooling and/or heating mode (CRC-ECM 43 MV/MO, representative model)													
Indicator	Unit	A1-A3	A4	A5	B2	B3	B4	B6	C1	C2	C3	C4	D
Components for re-use	kg	0	0	0	0	0	0	0	0	0	0	0	0
Material for recycling	kg	6,06E-05	0	2,09239E-05	0	0	0	0	0	0	1,22E-04	0	0
Materials for energy recovery	kg	0	0	0	0	0	0	0	0	0	0	0	0
Exported energy, electricity	MJ	0	0	0	0	0	0	0	0	0	0	0	0
Exported energy, thermal	MJ	0	0	0	0	0	0	0	0	0	0	0	0

Additional Environmental Information

Different scenarios for module B6

The following tables show different scenarios for module B6. Specifically, the results are reported for the B6 module depending on the European country in which the CRC-ECM 43 is used for all its lifetime.

Module B6: Results referred to 1 kWh of thermal energy exchanged with the air of the room in cooling and/or heating mode (CRC-ECM 43, MV/MO representative model)														
Indicator	Unit	Albania	Austria	Belgium	Bulgaria	Croatia	Estonia	Finland	France	Germany	Greece	Ireland	Italy	Sweden
GWP - total	kg CO ₂ eq.	0,25	0,73	0,50	1,60	1,28	0,40	0,24	0,22	1,25	2,15	1,12	1,12	0,08
GWP-GWP	kg CO ₂ eq.	0,22	0,75	0,59	1,58	1,30	1,14	0,45	0,23	1,18	1,91	1,09	1,07	0,07
ODP	kg CFC 11 eq.	0,13	1,16	1,52	0,43	1,26	1,10	0,40	0,46	0,68	3,31	4,59	1,41	0,03
AP	mol H ⁺ eq.	0,43	0,58	0,15	2,18	2,96	1,61	0,28	0,16	0,43	1,90	0,54	0,69	0,04
EP-freshwater	kg P eq.	0,40	0,81	0,06	3,62	1,63	0,17	0,14	0,03	1,79	2,86	0,07	0,19	0,02
EP-marine	kg N eq.	0,20	0,66	0,40	1,55	1,65	2,30	0,44	0,30	0,67	1,30	0,81	0,83	0,11
EP-terrestrial	mol N eq.	0,20	0,71	0,41	1,48	1,62	2,28	0,49	0,27	0,69	1,26	0,80	0,84	0,12
POCP	kg NMVOC eq.	0,21	0,72	0,39	1,44	1,72	2,29	0,43	0,29	0,67	1,73	0,80	1,17	0,08
ADP-minerals&metals	kg Sb eq.	0,08	222,71	0,99	1,95	0,61	0,65	0,89	1,74	1,10	0,48	0,14	0,25	0,70
ADP-fossil	MJ	0,09	0,40	1,06	1,82	0,82	0,67	1,09	1,93	0,80	0,67	0,15	0,25	0,79
WDP	m ³ eq	-3,41	0,49	0,85	1,52	1,67	0,71	0,92	0,34	0,14	1,99	0,50	2,99	0,71

Module B6: Results referred to 1 kWh of thermal energy exchanged with the air of the room in cooling and/or heating mode (CRC-ECM 43, MV/MO representative model)													
Indicator	Unit	Lithuania	Netherlands	Poland	Portugal	United Kingdom	Czech Republic	Russia	Serbia	Spain	Switzerland	Hungary	Norway
GWP - total	kg CO ₂ eq.	1,15	1,34	3,43	0,93	0,89	2,32	2,66	4,02	0,68	0,11	1,31	0,04
GWP-GWP	kg CO ₂ eq.	1,25	1,16	2,99	0,82	0,78	2,02	2,34	3,54	0,60	0,05	1,14	0,03
ODP	kg CFC 11 eq.	1,39	2,41	0,71	1,06	2,41	0,71	0,98	0,19	0,62	0,08	1,57	0,01
AP	mol H ⁺ eq.	0,77	0,33	4,25	0,74	0,37	1,59	1,98	10,80	0,47	0,03	1,11	0,01
EP-freshwater	kg P eq.	0,40	0,32	4,03	0,14	0,09	3,32	1,48	9,59	0,08	0,00	1,26	0,00
EP-marine	kg N eq.	1,16	0,78	3,56	0,86	0,81	1,89	2,08	3,80	0,75	0,06	1,12	0,01
EP-terrestrial	mol N eq.	1,14	0,83	3,55	0,88	0,89	1,85	2,03	3,67	0,74	0,07	1,13	0,01
POCP	kg NMVOC eq.	1,51	0,78	3,08	1,05	0,72	1,61	2,62	3,93	0,82	0,06	1,22	0,01
ADP-minerals&metals	kg Sb eq.	0,51	0,33	1,01	0,21	0,64	4,63	0,71	0,61	0,74	0,45	1,63	0,02
ADP-fossil	MJ	0,55	0,32	1,70	0,24	0,66	1,75	1,17	2,03	0,81	0,50	1,43	0,02
WDP	m ³ eq	0,97	0,58	1,52	2,32	0,10	1,28	2,23	1,80	2,41	0,25	1,18	0,25

GWP-GHG results of the “Best-Case Product”

The following table shows the GWP- GHG indicator for the CRC-ECM 73 +2 IV/IO model, the best-case product.

Results referred to 1 kWh of thermal energy exchanged with the air of the room in cooling and/or heating mode (CRC-ECM 73 +2 IV/IO, best-case product)													
Indicator	Unit	A1-A3	A4	A5	B2	B3	B4	B6	C1	C2	C3	C4	D
GWP-GHG	kg CO ₂ eq.	7,98E-04	1,18E-05	6,06E-07	0	0	0	1,07E-03	0	1,47E-06	4,48E-07	4,75E-06	-2,45E-04

GWP-GHG results of the “Worst-Case Product”

The following table shows the GWP- GHG indicator for the CRC-ECM 24 +1 MV/MO model, the worst-case product.

Results referred to 1 kWh of thermal energy exchanged with the air of the room in cooling and/or heating mode (CRC-ECM 24 +1 MV/MO, worst-case product)													
Indicator	Unit	A1-A3	A4	A5	B2	B3	B4	B6	C1	C2	C3	C4	D
GWP-GHG	kg CO ₂ eq.	2,46E-03	3,26E-05	1,78E-06	0	0	0	2,96E-03	0	3,66E-06	9,44E-07	2,00E-05	-5,02E-04

Conversion factors

Conversion coefficients are given for the environmental impact of the functional unit, **1 kWh of thermal energy exchanged with the air of the room in cooling and/or heating mode**. For each module of the life cycle, the environmental impacts of the product concerned are calculated by

multiplying the impacts of the declaration corresponding to the reference product by the conversion coefficient. The "Total" column should be calculated by adding the environmental impacts of each stage of the life cycle.

Indicator	CRC-ECM 23 MV/MO				CRC-ECM 63 MV/MO			CRC-ECM 73 MV/MO			CRC-ECM 93 MV/MO		
	A1-A3	B6	A4/A5/C2/C3/C4/D		A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D
GWP-GWP	1,42	1,88	1,42	0,89	0,89	0,90	0,80	0,88	0,82	0,64	1,28	0,65	0,65
ODP	1,43	1,88	1,42	0,89	0,89	0,90	0,80	0,88	0,82	0,63	1,28	0,65	0,65
AP	1,40	1,88	1,42	0,90	0,89	0,90	0,81	0,88	0,82	0,65	1,28	0,65	0,65
EP-freshwater	1,41	1,88	1,42	0,90	0,89	0,90	0,81	0,88	0,82	0,65	1,28	0,65	0,65
EP-marine	1,41	1,88	1,42	0,90	0,89	0,90	0,81	0,88	0,82	0,65	1,28	0,65	0,65
EP-terrestrial	1,41	1,88	1,42	0,90	0,89	0,90	0,81	0,88	0,82	0,65	1,28	0,65	0,65
POCP	1,41	1,88	1,42	0,90	0,89	0,90	0,81	0,88	0,82	0,64	1,28	0,65	0,65
ADP-minerals&metals	1,40	1,88	1,42	0,90	0,89	0,90	0,82	0,88	0,82	0,65	1,28	0,65	0,65
ADP-fossil	1,41	1,88	1,42	0,90	0,89	0,90	0,81	0,88	0,82	0,64	1,28	0,65	0,65
WDP	1,42	1,88	1,42	0,90	0,89	0,90	0,81	0,88	0,82	0,64	1,28	0,65	0,65

Indicator	CRC-ECM 23 IV/IO								CRC-ECM 43 IV/IO								CRC-ECM 63 IV/IO							
	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D
GWP-GWP	1,05	1,18	1,11	1,88	1,10	1,32	0,66	1,09	0,77	0,84	0,79	1,00	0,83	1,00	0,50	0,83	0,70	0,78	0,73	0,89	0,77	0,93	0,46	0,76
ODP	1,18	1,18	1,28	1,88	1,10	1,32	1,25	1,32	0,86	0,84	0,92	1,00	0,83	1,00	0,95	0,99	0,78	0,78	0,85	0,89	0,77	0,93	0,88	0,92
AP	1,21	1,18	1,26	1,88	1,10	1,32	1,13	1,27	0,91	0,84	0,90	1,00	0,83	1,00	0,85	0,96	0,84	0,78	0,83	0,89	0,77	0,93	0,79	0,89
EP-freshwater	1,22	1,18	1,30	1,88	1,10	1,32	1,24	1,29	0,92	0,84	0,93	1,00	0,83	1,00	0,94	0,98	0,84	0,78	0,86	0,89	0,77	0,93	0,87	0,90
EP-marine	1,12	1,18	1,26	1,88	1,10	1,32	1,04	1,22	0,84	0,84	0,90	1,00	0,83	1,00	0,78	0,92	0,77	0,78	0,83	0,89	0,77	0,93	0,72	0,85
EP-terrestrial	1,14	1,18	1,25	1,88	1,10	1,32	1,11	1,24	0,85	0,84	0,90	1,00	0,83	1,00	0,84	0,93	0,79	0,78	0,83	0,89	0,77	0,93	0,78	0,86
POCP	1,13	1,18	1,27	1,88	1,10	1,32	1,13	1,21	0,84	0,84	0,91	1,00	0,83	1,00	0,86	0,91	0,77	0,78	0,84	0,89	0,77	0,93	0,79	0,84
ADP-minerals&metals	1,28	1,18	1,32	1,88	1,10	1,32	1,24	1,32	0,96	0,84	0,94	1,00	0,83	1,00	0,93	0,99	0,89	0,78	0,87	0,89	0,77	0,93	0,86	0,92
ADP-fossil	1,09	1,18	1,31	1,88	1,10	1,32	1,36	1,22	0,81	0,84	0,94	1,00	0,83	1,00	1,03	0,92	0,75	0,78	0,87	0,89	0,77	0,93	0,95	0,85
WDP	1,05	1,18	1,40	1,88	1,10	1,32	1,33	1,08	0,78	0,84	1,00	1,00	0,83	1,00	1,01	0,82	0,71	0,78	0,93	0,89	0,77	0,93	0,93	0,75

Indicator	CRC-ECM 73 IV/IO								CRC-ECM 93 IV/IO							
	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D
GWP-GWP	0,64	0,72	0,68	0,88	0,71	0,85	0,42	0,70	0,51	0,58	0,55	1,28	0,57	0,68	0,34	0,56
ODP	0,71	0,72	0,79	0,88	0,71	0,85	0,80	0,84	0,57	0,58	0,63	1,28	0,57	0,68	0,65	0,68
AP	0,77	0,72	0,77	0,88	0,71	0,85	0,72	0,81	0,62	0,58	0,62	1,28	0,57	0,68	0,58	0,65
EP-freshwater	0,77	0,72	0,80	0,88	0,71	0,85	0,79	0,83	0,62	0,58	0,64	1,28	0,57	0,68	0,64	0,67
EP-marine	0,70	0,72	0,77	0,88	0,71	0,85	0,66	0,78	0,57	0,58	0,62	1,28	0,57	0,68	0,54	0,63
EP-terrestrial	0,72	0,72	0,77	0,88	0,71	0,85	0,71	0,79	0,58	0,58	0,62	1,28	0,57	0,68	0,57	0,64
POCP	0,70	0,72	0,78	0,88	0,71	0,85	0,72	0,77	0,57	0,58	0,63	1,28	0,57	0,68	0,58	0,62
ADP-minerals&metals	0,81	0,72	0,81	0,88	0,71	0,85	0,79	0,84	0,66	0,58	0,65	1,28	0,57	0,68	0,64	0,68
ADP-fossil	0,68	0,72	0,80	0,88	0,71	0,85	0,87	0,78	0,55	0,58	0,64	1,28	0,57	0,68	0,70	0,63
WDP	0,65	0,72	0,86	0,88	0,71	0,85	0,85	0,69	0,52	0,58	0,69	1,28	0,57	0,68	0,69	0,56

Indicator	CRC-ECM 24 MV/MO			CRC-ECM 44 MV/MO			CRC-ECM 64 MV/MO			CRC-ECM 74 MV/MO			CRC-ECM 94 MV/MO		
	A1-A3	B6	A4/A5/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D
GWP-GWP	1,41	1,78	1,39	1,02	0,98	1,03	0,88	0,84	0,90	0,83	0,86	0,84	0,61	1,24	0,65
ODP	1,42	1,78	1,39	1,02	0,98	1,03	0,88	0,84	0,90	0,82	0,86	0,84	0,61	1,24	0,65
AP	1,39	1,78	1,39	1,02	0,98	1,03	0,89	0,84	0,90	0,84	0,86	0,84	0,62	1,24	0,65
EP-freshwater	1,40	1,78	1,39	1,02	0,98	1,03	0,89	0,84	0,90	0,84	0,86	0,84	0,62	1,24	0,65
EP-marine	1,40	1,78	1,39	1,02	0,98	1,03	0,89	0,84	0,90	0,83	0,86	0,84	0,62	1,24	0,65
EP-terrestrial	1,40	1,78	1,39	1,02	0,98	1,03	0,89	0,84	0,90	0,84	0,86	0,84	0,62	1,24	0,65
POCP	1,40	1,78	1,39	1,02	0,98	1,03	0,89	0,84	0,90	0,83	0,86	0,84	0,62	1,24	0,65
ADP-minerals&metals	1,39	1,78	1,39	1,02	0,98	1,03	0,89	0,84	0,90	0,84	0,86	0,84	0,63	1,24	0,65
ADP-fossil	1,40	1,78	1,39	1,02	0,98	1,03	0,89	0,84	0,90	0,83	0,86	0,84	0,62	1,24	0,65
WDP	1,40	1,78	1,39	1,02	0,98	1,03	0,89	0,84	0,90	0,83	0,86	0,84	0,62	1,24	0,65

Indicator	CRC-ECM 24 IV/IO								CRC-ECM 44 IV/IO								CRC-ECM 64 IV/IO							
	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D
GWP-GWP	1,05	1,17	1,10	1,78	1,12	1,34	0,66	1,10	0,80	0,87	0,82	0,98	0,87	1,04	0,52	0,86	0,70	0,77	0,73	0,84	0,77	0,93	0,46	0,86
ODP	1,18	1,17	1,27	1,78	1,12	1,34	1,27	1,33	0,89	0,87	0,94	0,98	0,87	1,04	0,99	1,03	0,78	0,77	0,84	0,84	0,77	0,93	0,88	1,03
AP	1,22	1,17	1,25	1,78	1,12	1,34	1,14	1,28	0,94	0,87	0,93	0,98	0,87	1,04	0,89	1,00	0,84	0,77	0,83	0,84	0,77	0,93	0,79	1,00
EP-freshwater	1,23	1,17	1,29	1,78	1,12	1,34	1,25	1,31	0,95	0,87	0,96	0,98	0,87	1,04	0,97	1,02	0,85	0,77	0,85	0,84	0,77	0,93	0,87	1,02
EP-marine	1,13	1,17	1,25	1,78	1,12	1,34	1,05	1,24	0,87	0,87	0,93	0,98	0,87	1,04	0,81	0,96	0,77	0,77	0,83	0,84	0,77	0,93	0,73	0,96
EP-terrestrial	1,15	1,17	1,25	1,78	1,12	1,34	1,12	1,25	0,89	0,87	0,92	0,98	0,87	1,04	0,87	0,97	0,79	0,77	0,83	0,84	0,77	0,93	0,78	0,97
POCP	1,14	1,17	1,27	1,78	1,12	1,34	1,14	1,22	0,87	0,87	0,94	0,98	0,87	1,04	0,89	0,95	0,77	0,77	0,84	0,84	0,77	0,93	0,79	0,95
ADP-minerals&metals	1,29	1,17	1,31	1,78	1,12	1,34	1,25	1,33	1,00	0,87	0,97	0,98	0,87	1,04	0,97	1,03	0,89	0,77	0,87	0,84	0,77	0,93	0,87	1,03
ADP-fossil	1,10	1,17	1,30	1,78	1,12	1,34	1,37	1,23	0,84	0,87	0,96	0,98	0,87	1,04	1,07	0,96	0,75	0,77	0,86	0,84	0,77	0,93	0,95	0,96
WDP	1,05	1,17	1,39	1,78	1,12	1,34	1,35	1,09	0,81	0,87	1,03	0,98	0,87	1,04	1,05	0,85	0,71	0,77	0,92	0,84	0,77	0,93	0,93	0,85

Indicator	CRC-ECM 74 IV/IO								CRC-ECM 94 IV/IO							
	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D
GWP-GWP	0,67	0,75	0,70	0,86	0,74	0,89	0,44	0,73	0,52	0,58	0,55	1,24	0,58	0,70	0,35	0,73
ODP	0,74	0,75	0,81	0,86	0,74	0,89	0,84	0,88	0,58	0,58	0,64	1,24	0,58	0,70	0,66	0,88
AP	0,80	0,75	0,80	0,86	0,74	0,89	0,76	0,85	0,63	0,58	0,62	1,24	0,58	0,70	0,60	0,85
EP-freshwater	0,81	0,75	0,82	0,86	0,74	0,89	0,83	0,87	0,63	0,58	0,64	1,24	0,58	0,70	0,65	0,87
EP-marine	0,74	0,75	0,79	0,86	0,74	0,89	0,69	0,82	0,58	0,58	0,62	1,24	0,58	0,70	0,55	0,82
EP-terrestrial	0,75	0,75	0,79	0,86	0,74	0,89	0,74	0,83	0,59	0,58	0,62	1,24	0,58	0,70	0,59	0,83
POCP	0,73	0,75	0,81	0,86	0,74	0,89	0,76	0,81	0,58	0,58	0,63	1,24	0,58	0,70	0,60	0,81
ADP-minerals&metals	0,85	0,75	0,83	0,86	0,74	0,89	0,83	0,88	0,67	0,58	0,65	1,24	0,58	0,70	0,65	0,88
ADP-fossil	0,71	0,75	0,83	0,86	0,74	0,89	0,91	0,81	0,56	0,58	0,65	1,24	0,58	0,70	0,72	0,81
WDP	0,68	0,75	0,89	0,86	0,74	0,89	0,89	0,72	0,53	0,58	0,69	1,24	0,58	0,70	0,70	0,72

Indicator	CRC-ECM 23+1 MV/MO			CRC-ECM 43+1 MV/MO			CRC-ECM 63+1 MV/MO			CRC-ECM 73+1 MV/MO			CRC-ECM 93+1 MV/MO		
	A1-A3	B6	A4/A5/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D
GWP-GWP	1,42	2,03	1,58	1,00	1,08	1,14	0,90	0,97	1,03	0,80	0,94	0,93	0,68	1,59	0,79
ODP	1,44	2,03	1,58	1,01	1,08	1,14	0,90	0,97	1,03	0,80	0,94	0,93	0,68	1,59	0,79
AP	1,39	2,03	1,58	1,00	1,08	1,14	0,91	0,97	1,03	0,81	0,94	0,93	0,69	1,59	0,79
EP-freshwater	1,40	2,03	1,58	1,00	1,08	1,14	0,91	0,97	1,03	0,81	0,94	0,93	0,69	1,59	0,79
EP-marine	1,40	2,03	1,58	1,00	1,08	1,14	0,91	0,97	1,03	0,81	0,94	0,93	0,69	1,59	0,79
EP-terrestrial	1,40	2,03	1,58	1,00	1,08	1,14	0,91	0,97	1,03	0,81	0,94	0,93	0,69	1,59	0,79
POCP	1,40	2,03	1,58	1,00	1,08	1,14	0,91	0,97	1,03	0,81	0,94	0,93	0,69	1,59	0,79
ADP-minerals&metals	1,39	2,03	1,58	1,00	1,08	1,14	0,91	0,97	1,03	0,81	0,94	0,93	0,69	1,59	0,79
ADP-fossil	1,40	2,03	1,58	1,00	1,08	1,14	0,91	0,97	1,03	0,81	0,94	0,93	0,69	1,59	0,79
WDP	1,41	2,03	1,58	1,00	1,08	1,14	0,90	0,97	1,03	0,80	0,94	0,93	0,69	1,59	0,79

Indicator	CRC-ECM 23+1 IV/IO								CRC-ECM 43+1 IV/IO								CRC-ECM 63+1 IV/IO							
	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D
GWP-GWP	1,20	1,33	1,26	2,03	1,27	1,52	0,76	1,26	0,89	0,97	0,91	1,08	0,97	1,16	0,58	0,96	0,82	0,90	0,85	0,97	0,90	1,08	0,53	0,96
ODP	1,35	1,33	1,45	2,03	1,27	1,52	1,44	1,51	0,99	0,97	1,05	1,08	0,97	1,16	1,10	1,15	0,90	0,90	0,98	0,97	0,90	1,08	1,02	1,15
AP	1,39	1,33	1,42	2,03	1,27	1,52	1,30	1,46	1,05	0,97	1,03	1,08	0,97	1,16	0,99	1,11	0,98	0,90	0,96	0,97	0,90	1,08	0,92	1,11
EP-freshwater	1,40	1,33	1,47	2,03	1,27	1,52	1,43	1,49	1,06	0,97	1,07	1,08	0,97	1,16	1,09	1,13	0,98	0,90	0,99	0,97	0,90	1,08	1,01	1,13
EP-marine	1,29	1,33	1,42	2,03	1,27	1,52	1,19	1,41	0,97	0,97	1,03	1,08	0,97	1,16	0,91	1,07	0,90	0,90	0,96	0,97	0,90	1,08	0,84	1,07
EP-terrestrial	1,31	1,33	1,42	2,03	1,27	1,52	1,28	1,42	0,99	0,97	1,03	1,08	0,97	1,16	0,97	1,08	0,91	0,90	0,96	0,97	0,90	1,08	0,90	1,08
POCP	1,29	1,33	1,44	2,03	1,27	1,52	1,30	1,39	0,97	0,97	1,05	1,08	0,97	1,16	0,99	1,06	0,90	0,90	0,97	0,97	0,90	1,08	0,92	1,06
ADP-minerals&metals	1,47	1,33	1,49	2,03	1,27	1,52	1,42	1,51	1,12	0,97	1,08	1,08	0,97	1,16	1,08	1,15	1,04	0,90	1,01	0,97	0,90	1,08	1,00	1,15
ADP-fossil	1,25	1,33	1,48	2,03	1,27	1,52	1,57	1,40	0,94	0,97	1,07	1,08	0,97	1,16	1,19	1,06	0,87	0,90	1,00	0,97	0,90	1,08	1,11	1,06
WDP	1,20	1,33	1,58	2,03	1,27	1,52	1,53	1,24	0,90	0,97	1,15	1,08	0,97	1,16	1,17	0,95	0,83	0,90	1,07	0,97	0,90	1,08	1,08	0,95

Indicator	CRC-ECM 73+1 IV/IO								CRC-ECM 93+1 IV/IO							
	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D
GWP-GWP	0,74	0,82	0,78	0,94	0,82	0,98	0,49	0,81	0,63	0,70	0,66	1,59	0,70	0,85	0,42	0,70
ODP	0,82	0,82	0,89	0,94	0,82	0,98	0,93	0,98	0,70	0,70	0,77	1,59	0,70	0,85	0,80	0,84
AP	0,89	0,82	0,88	0,94	0,82	0,98	0,84	0,94	0,76	0,70	0,75	1,59	0,70	0,85	0,72	0,81
EP-freshwater	0,89	0,82	0,91	0,94	0,82	0,98	0,92	0,96	0,77	0,70	0,78	1,59	0,70	0,85	0,79	0,83
EP-marine	0,82	0,82	0,88	0,94	0,82	0,98	0,77	0,91	0,70	0,70	0,75	1,59	0,70	0,85	0,66	0,78
EP-terrestrial	0,83	0,82	0,88	0,94	0,82	0,98	0,82	0,92	0,71	0,70	0,75	1,59	0,70	0,85	0,71	0,79
POCP	0,82	0,82	0,89	0,94	0,82	0,98	0,84	0,90	0,70	0,70	0,76	1,59	0,70	0,85	0,72	0,77
ADP-minerals&metals	0,95	0,82	0,92	0,94	0,82	0,98	0,92	0,98	0,81	0,70	0,79	1,59	0,70	0,85	0,79	0,84
ADP-fossil	0,79	0,82	0,91	0,94	0,82	0,98	1,01	0,90	0,68	0,70	0,78	1,59	0,70	0,85	0,87	0,78
WDP	0,75	0,82	0,98	0,94	0,82	0,98	0,99	0,80	0,64	0,70	0,84	1,59	0,70	0,85	0,85	0,69

Indicator	CRC-ECM 23+2 MV/MO			CRC-ECM 43+2 MV/MO			CRC-ECM 63+2 MV/MO			CRC-ECM 73+2 MV/MO			CRC-ECM 93+2 MV/MO		
	A1-A3	B6	A4/A5/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D
GWP-GWP	1,09	1,50	1,21	0,80	0,84	0,91	0,69	0,72	0,69	0,62	0,70	0,72	0,50	1,06	0,58
ODP	1,10	1,50	1,21	0,80	0,84	0,91	0,69	0,72	0,69	0,62	0,70	0,72	0,50	1,06	0,58
AP	1,07	1,50	1,21	0,80	0,84	0,91	0,70	0,72	0,70	0,63	0,70	0,72	0,51	1,06	0,58
EP-freshwater	1,08	1,50	1,21	0,80	0,84	0,91	0,70	0,72	0,70	0,63	0,70	0,72	0,51	1,06	0,58
EP-marine	1,08	1,50	1,21	0,80	0,84	0,91	0,70	0,72	0,70	0,63	0,70	0,72	0,51	1,06	0,58
EP-terrestrial	1,08	1,50	1,21	0,80	0,84	0,91	0,70	0,72	0,70	0,63	0,70	0,72	0,51	1,06	0,58
POCP	1,08	1,50	1,21	0,80	0,84	0,91	0,70	0,72	0,70	0,62	0,70	0,72	0,51	1,06	0,58
ADP-minerals&metals	1,07	1,50	1,21	0,80	0,84	0,91	0,70	0,72	0,70	0,63	0,70	0,72	0,51	1,06	0,58
ADP-fossil	1,08	1,50	1,21	0,80	0,84	0,91	0,70	0,72	0,70	0,62	0,70	0,72	0,51	1,06	0,58
WDP	1,09	1,50	1,21	0,80	0,84	0,91	0,69	0,72	0,69	0,62	0,70	0,72	0,50	1,06	0,58

Indicator	CRC-ECM 23+2 IV/IO								CRC-ECM 43+2 IV/IO								CRC-ECM 63+2 IV/IO							
	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D
GWP-GWP	0,93	1,02	0,96	1,50	0,99	1,19	0,59	0,98	0,72	0,78	0,73	0,84	0,79	0,94	0,47	0,78	0,63	0,69	0,65	0,72	0,69	0,83	0,41	0,78
ODP	1,04	1,02	1,11	1,50	0,99	1,19	1,12	1,18	0,80	0,78	0,85	0,84	0,79	0,94	0,89	0,94	0,69	0,69	0,75	0,72	0,69	0,83	0,79	0,94
AP	1,08	1,02	1,09	1,50	0,99	1,19	1,01	1,14	0,85	0,78	0,83	0,84	0,79	0,94	0,80	0,90	0,75	0,69	0,74	0,72	0,69	0,83	0,71	0,90
EP-freshwater	1,09	1,02	1,13	1,50	0,99	1,19	1,11	1,16	0,86	0,78	0,86	0,84	0,79	0,94	0,88	0,92	0,76	0,69	0,76	0,72	0,69	0,83	0,78	0,92
EP-marine	1,00	1,02	1,09	1,50	0,99	1,19	0,93	1,10	0,79	0,78	0,83	0,84	0,79	0,94	0,74	0,87	0,69	0,69	0,73	0,72	0,69	0,83	0,65	0,87
EP-terrestrial	1,02	1,02	1,09	1,50	0,99	1,19	0,99	1,11	0,80	0,78	0,83	0,84	0,79	0,94	0,79	0,88	0,70	0,69	0,73	0,72	0,69	0,83	0,70	0,88
POCP	1,00	1,02	1,11	1,50	0,99	1,19	1,01	1,08	0,79	0,78	0,84	0,84	0,79	0,94	0,81	0,86	0,69	0,69	0,74	0,72	0,69	0,83	0,71	0,86
ADP-minerals&metals	1,14	1,02	1,14	1,50	0,99	1,19	1,11	1,18	0,91	0,78	0,87	0,84	0,79	0,94	0,88	0,94	0,80	0,69	0,77	0,72	0,69	0,83	0,77	0,94
ADP-fossil	0,97	1,02	1,14	1,50	0,99	1,19	1,22	1,09	0,76	0,78	0,87	0,84	0,79	0,94	0,97	0,87	0,67	0,69	0,77	0,72	0,69	0,83	0,85	0,87
WDP	0,93	1,02	1,21	1,50	0,99	1,19	1,19	0,97	0,73	0,78	0,93	0,84	0,79	0,94	0,95	0,77	0,64	0,69	0,82	0,72	0,69	0,83	0,83	0,77

Indicator	CRC-ECM 73+2 IV/IO								CRC-ECM 93+2 IV/IO							
	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D
GWP-GWP	0,57	0,64	0,60	0,70	0,64	0,76	0,38	0,78	0,47	0,52	0,49	1,06	0,52	0,63	0,31	0,52
ODP	0,63	0,64	0,69	0,70	0,64	0,76	0,72	0,94	0,52	0,52	0,57	1,06	0,52	0,63	0,59	0,62
AP	0,69	0,64	0,68	0,70	0,64	0,76	0,65	0,90	0,56	0,52	0,56	1,06	0,52	0,63	0,53	0,60
EP-freshwater	0,69	0,64	0,70	0,70	0,64	0,76	0,71	0,92	0,57	0,52	0,57	1,06	0,52	0,63	0,59	0,61
EP-marine	0,63	0,64	0,68	0,70	0,64	0,76	0,60	0,87	0,52	0,52	0,56	1,06	0,52	0,63	0,49	0,58
EP-terrestrial	0,64	0,64	0,68	0,70	0,64	0,76	0,64	0,88	0,53	0,52	0,56	1,06	0,52	0,63	0,52	0,58
POCP	0,63	0,64	0,69	0,70	0,64	0,76	0,65	0,86	0,52	0,52	0,56	1,06	0,52	0,63	0,54	0,57
ADP-minerals&metals	0,73	0,64	0,71	0,70	0,64	0,76	0,71	0,94	0,60	0,52	0,58	1,06	0,52	0,63	0,58	0,62
ADP-fossil	0,61	0,64	0,71	0,70	0,64	0,76	0,78	0,87	0,50	0,52	0,58	1,06	0,52	0,63	0,64	0,57
WDP	0,58	0,64	0,76	0,70	0,64	0,76	0,77	0,77	0,47	0,52	0,62	1,06	0,52	0,63	0,63	0,51

Indicator	CRC-ECM 24+1 MV/MO			CRC-ECM 44+1 MV/MO			CRC-ECM 64+1 MV/MO			CRC-ECM 74+1 MV/MO			CRC-ECM 94+1 MV/MO		
	A1-A3	B6	A4/A5/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D	A1-A3	B6	A4/C2/C3/C4/D
GWP-GWP	1,76	1,95	1,60	1,04	1,07	1,17	0,92	0,94	1,04	0,63	0,70	0,73	0,59	1,24	0,69
ODP	1,77	1,95	1,60	1,04	1,07	1,17	0,91	0,94	1,04	0,63	0,70	0,73	0,59	1,24	0,69
AP	1,75	1,95	1,60	1,04	1,07	1,17	0,93	0,94	1,04	0,64	0,70	0,73	0,60	1,24	0,69
EP-freshwater	1,75	1,95	1,60	1,04	1,07	1,17	0,92	0,94	1,04	0,64	0,70	0,73	0,60	1,24	0,69
EP-marine	1,76	1,95	1,60	1,04	1,07	1,17	0,92	0,94	1,04	0,64	0,70	0,73	0,60	1,24	0,69
EP-terrestrial	1,76	1,95	1,60	1,04	1,07	1,17	0,92	0,94	1,04	0,64	0,70	0,73	0,60	1,24	0,69
POCP	1,76	1,95	1,60	1,04	1,07	1,17	0,92	0,94	1,04	0,63	0,70	0,73	0,60	1,24	0,69
ADP-minerals&metals	1,75	1,95	1,60	1,04	1,07	1,17	0,93	0,94	1,04	0,64	0,70	0,73	0,60	1,24	0,69
ADP-fossil	1,76	1,95	1,60	1,04	1,07	1,17	0,92	0,94	1,04	0,63	0,70	0,73	0,60	1,24	0,69
WDP	1,76	1,95	1,60	1,04	1,07	1,17	0,92	0,94	1,04	0,63	0,70	0,73	0,60	1,24	0,69

Indicator	CRC-ECM 24+1 IV/IO								CRC-ECM 44+1 IV/IO								CRC-ECM 64+1 IV/IO							
	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D
GWP-GWP	1,22	1,35	1,27	1,95	1,30	1,56	0,77	1,29	0,93	1,01	0,95	1,07	1,01	1,21	0,60	1,00	0,84	0,92	0,87	0,94	0,92	1,11	0,55	0,91
ODP	1,37	1,35	1,46	1,95	1,30	1,56	1,48	1,55	1,03	1,01	1,10	1,07	1,01	1,21	1,14	1,20	0,92	0,92	1,00	0,94	0,92	1,11	1,05	1,10
AP	1,42	1,35	1,44	1,95	1,30	1,56	1,33	1,50	1,10	1,01	1,08	1,07	1,01	1,21	1,03	1,16	1,00	0,92	0,98	0,94	0,92	1,11	0,94	1,06
EP-freshwater	1,43	1,35	1,48	1,95	1,30	1,56	1,46	1,52	1,10	1,01	1,11	1,07	1,01	1,21	1,13	1,18	1,01	0,92	1,01	0,94	0,92	1,11	1,03	1,08
EP-marine	1,32	1,35	1,43	1,95	1,30	1,56	1,22	1,44	1,01	1,01	1,07	1,07	1,01	1,21	0,95	1,12	0,92	0,92	0,98	0,94	0,92	1,11	0,87	1,02
EP-terrestrial	1,34	1,35	1,43	1,95	1,30	1,56	1,31	1,46	1,03	1,01	1,07	1,07	1,01	1,21	1,01	1,13	0,94	0,92	0,98	0,94	0,92	1,11	0,93	1,03
POCP	1,32	1,35	1,46	1,95	1,30	1,56	1,34	1,42	1,01	1,01	1,09	1,07	1,01	1,21	1,03	1,10	0,92	0,92	0,99	0,94	0,92	1,11	0,95	1,01
ADP-minerals&metals	1,50	1,35	1,50	1,95	1,30	1,56	1,46	1,55	1,16	1,01	1,13	1,07	1,01	1,21	1,13	1,20	1,06	0,92	1,03	0,94	0,92	1,11	1,03	1,10
ADP-fossil	1,28	1,35	1,49	1,95	1,30	1,56	1,60	1,43	0,98	1,01	1,12	1,07	1,01	1,21	1,24	1,11	0,89	0,92	1,02	0,94	0,92	1,11	1,14	1,02
WDP	1,23	1,35	1,60	1,95	1,30	1,56	1,57	1,27	0,93	1,01	1,20	1,07	1,01	1,21	1,21	0,98	0,85	0,92	1,09	0,94	0,92	1,11	1,11	0,90

Indicator	CRC-ECM 74+1 IV/IO								CRC-ECM 94+1 IV/IO							
	A1-A3	A4	A5	B6	C2	C3	C4	D	A1-A3	A4	A5	B6	C2	C3	C4	D
GWP-GWP	0,67	0,75	0,70	0,86	0,74	0,89	0,44	0,73	0,52	0,58	0,55	1,24	0,58	0,70	0,35	0,73
ODP	0,74	0,75	0,81	0,86	0,74	0,89	0,84	0,88	0,58	0,58	0,64	1,24	0,58	0,70	0,66	0,88
AP	0,80	0,75	0,80	0,86	0,74	0,89	0,76	0,85	0,63	0,58	0,62	1,24	0,58	0,70	0,60	0,85
EP-freshwater	0,81	0,75	0,82	0,86	0,74	0,89	0,83	0,87	0,63	0,58	0,64	1,24	0,58	0,70	0,65	0,87
EP-marine	0,74	0,75	0,79	0,86	0,74	0,89	0,69	0,82	0,58	0,58	0,62	1,24	0,58	0,70	0,55	0,82
EP-terrestrial	0,75	0,75	0,79	0,86	0,74	0,89	0,74	0,83	0,59	0,58	0,62	1,24	0,58	0,70	0,59	0,83
POCP	0,73	0,75	0,81	0,86	0,74	0,89	0,76	0,81	0,58	0,58	0,63	1,24	0,58	0,70	0,60	0,81
ADP-minerals&metals	0,85	0,75	0,83	0,86	0,74	0,89	0,83	0,88	0,67	0,58	0,65	1,24	0,58	0,70	0,65	0,88
ADP-fossil	0,71	0,75	0,83	0,86	0,74	0,89	0,91	0,81	0,56	0,58	0,65	1,24	0,58	0,70	0,72	0,81
WDP	0,68	0,75	0,89	0,86	0,74	0,89	0,89	0,72	0,53	0,58	0,69	1,24	0,58	0,70	0,70	0,72

Additional Information

Thermal/Electrical Energy Calculation

The total thermal energy provided/to subtracted from the air of the room and the total electrical energy consumption along fan coil lifetime is been calculated by the following formula (based on *Technical Certification Rules Of The Eurovent Certified Performance Mark – Fan Coil Unit – Rev 00 2021*):

$$\text{Total Thermal Energy (kWh)} = \text{Cooling Energy} + \text{Heating Energy}$$

where:

$$\begin{aligned} \text{Cooling Energy} &= (5\% P (c)_{high} + 30\% P (c)_{med} + 65\% P (c)_{low}) * h_{cooling} * \text{Lifetime} \\ \text{Heating Energy} &= (5\% P (h)_{high} + 25\% P (h)_{med} + 70\% P (h)_{low}) * h_{heating} * \text{Lifetime} \end{aligned}$$

$$\text{Total Electrical Consumption (kWh)} = \text{Cooling Electrical Consumption} + \text{Heating Electrical Consumption}$$

where:

$$\begin{aligned} \text{Cooling Consumption} &= (5\% Pe (c)_{high} + 30\% Pe (c)_{med} + 65\% Pe (c)_{low}) * h_{cooling} * \text{Lifetime} \\ \text{Heating Consumption} &= (5\% Pe (h)_{high} + 25\% Pe (h)_{med} + 70\% Pe (h)_{low}) * h_{heating} * \text{Lifetime} \end{aligned}$$

- $P (c)_{high} / P (c)_{med} / P (c)_{low}$ = Total Cooling Capacity (kW) at high/med/low speed in cooling mode at standard rating conditions, according to EN1397
- $Pe (c)_{high} / Pe (c)_{med} / Pe (c)_{low}$ = Total Electrical Power Input (kW) at high/med/low speed in cooling mode according to EN1397
- $P (h)_{high} / P (h)_{med} / P (h)_{low}$ = Heating Capacity (kW) at high/med/low speed in cooling mode at standard rating conditions, according to EN1397
- $Pe (h)_{high} / Pe (h)_{med} / Pe (h)_{low}$ = Total Electrical Power Input (kW) at high/med/low speed in heating mode according to EN1397
- Medium speed is the standard fan speed as defined in EN 1397 (having 0Pa at inlet of the unit and 50 Pa at outlet of the unit), low/high speed are the other two speeds measured according to EN 1397
- $h_{cooling}$ and $h_{heating}$ are the yearly operational hours in cooling (1100hrs) and average heating (1500hrs) mode
- Lifetime= 20 years

Model	Total Thermal Energy (kWh)	Total Electrical Consumption (kWh)
CRC-ECM 23	48.521,00	456,80
CRC-ECM 24	51.394,00	456,80
CRC-ECM 43	89.276,00	446,00
CRC-ECM 44	90.968,00	446,00
CRC-ECM 63	121.592,00	541,80
CRC-ECM 64	128.995,00	541,80
CRC-ECM 73	156.182,00	685,15
CRC-ECM 74	159.280,00	685,15
CRC-ECM 93	218.218,00	1400,30
CRC-ECM 94	226.547,00	1400,30
CRC-ECM 23+1	45.131,00	456,80
CRC-ECM 23+2	61.001,00	456,80
CRC-ECM 24+1	46.924,00	456,80
CRC-ECM 43+1	82.376,00	446,00
CRC-ECM 43+2	106.136,00	446,00
CRC-ECM 44+1	83.498,00	446,00
CRC-ECM 63+1	111.887,00	541,80
CRC-ECM 63+2	150.647,00	541,80
CRC-ECM 64+1	115.495,00	541,80
CRC-ECM 73+1	145.322,00	685,15
CRC-ECM 73+2	194.537,00	685,15
CRC-ECM 74+1	146.785,00	685,15
CRC-ECM 93+1	189.058,00	1497,80
CRC-ECM 93+2	264.103,00	1400,30
CRC-ECM 94+1	194.492,00	1400,30

References

AIB, "European Residual Mixes -Results of the calculation of Residual Mixes for the calendar year 2023"

CEN (2019) EN 15804:2012+A2:2019, Sustainability of construction works – Environmental product declarations – Core rules for the product category of construction products.

Central Product Classification (CPC) Series M No.77, v.2.1. United Nations, New York, 2015

CONAI (Consorzio Nazionale Imballaggi), 2023 (www.conai.org)

c-PCR-027 Fan coils (c-PCR to PCR 2019:14) (2023-12-19)

Database Ecoinvent v.3.10 (www.ecoinvent.org)

Default list v. 2.0 of environmental impact indicators: the International EPD System (www.environdec.com)

EPD International (2021) General Programme Instructions for the International EPD[®] System. v. 4.0, dated 2021-03-29. (www.environdec.com)

EN1397:221, Heat Exchangers, Hydronic room fan coil units, Test procedures for establishing performances

ISO 14025:2006, Environmental labels and declaration – Type III environmental declarations – Principles and procedures.

ISO 14040:2021, Environmental management – Life cycle assessment – Principles and framework.

ISO 14044: 2021, Environmental management – Life cycle assessment – Requirements and guidelines.

LCA Report Sabiana – Fan Coils – Carisma CRC-ECM v.2

PCR 2019:14, Construction Products v. 1.3.4 valid until: 2025-06-20

PCR Part A for Building-Related Products and Services v.4 of UL Environment framework (www.ul.com)

Technical Certification Rules Of The Eurovent Certified Performance Mark – Fan Coil Unit – Rev 00 2021

Contact Information

EPD Owner: Sabiana S.p.A.

Address: Via Piave, 53, 20011 Corbetta (MI), Italy

Phone: +39 02972031

E-mail: info@sabiana.it



www.sabiana.it

LCA Consultancy: Tetis Institute S.r.l

Address: Via Gropallo 4/19, 16122 Genova (GE), Italy

E-mail: info@tetisinstitute.it



www.tetisinstitute.it